


Typical Tradewaste Separator Discharge Installation



Flowmeter Display / Transmitter

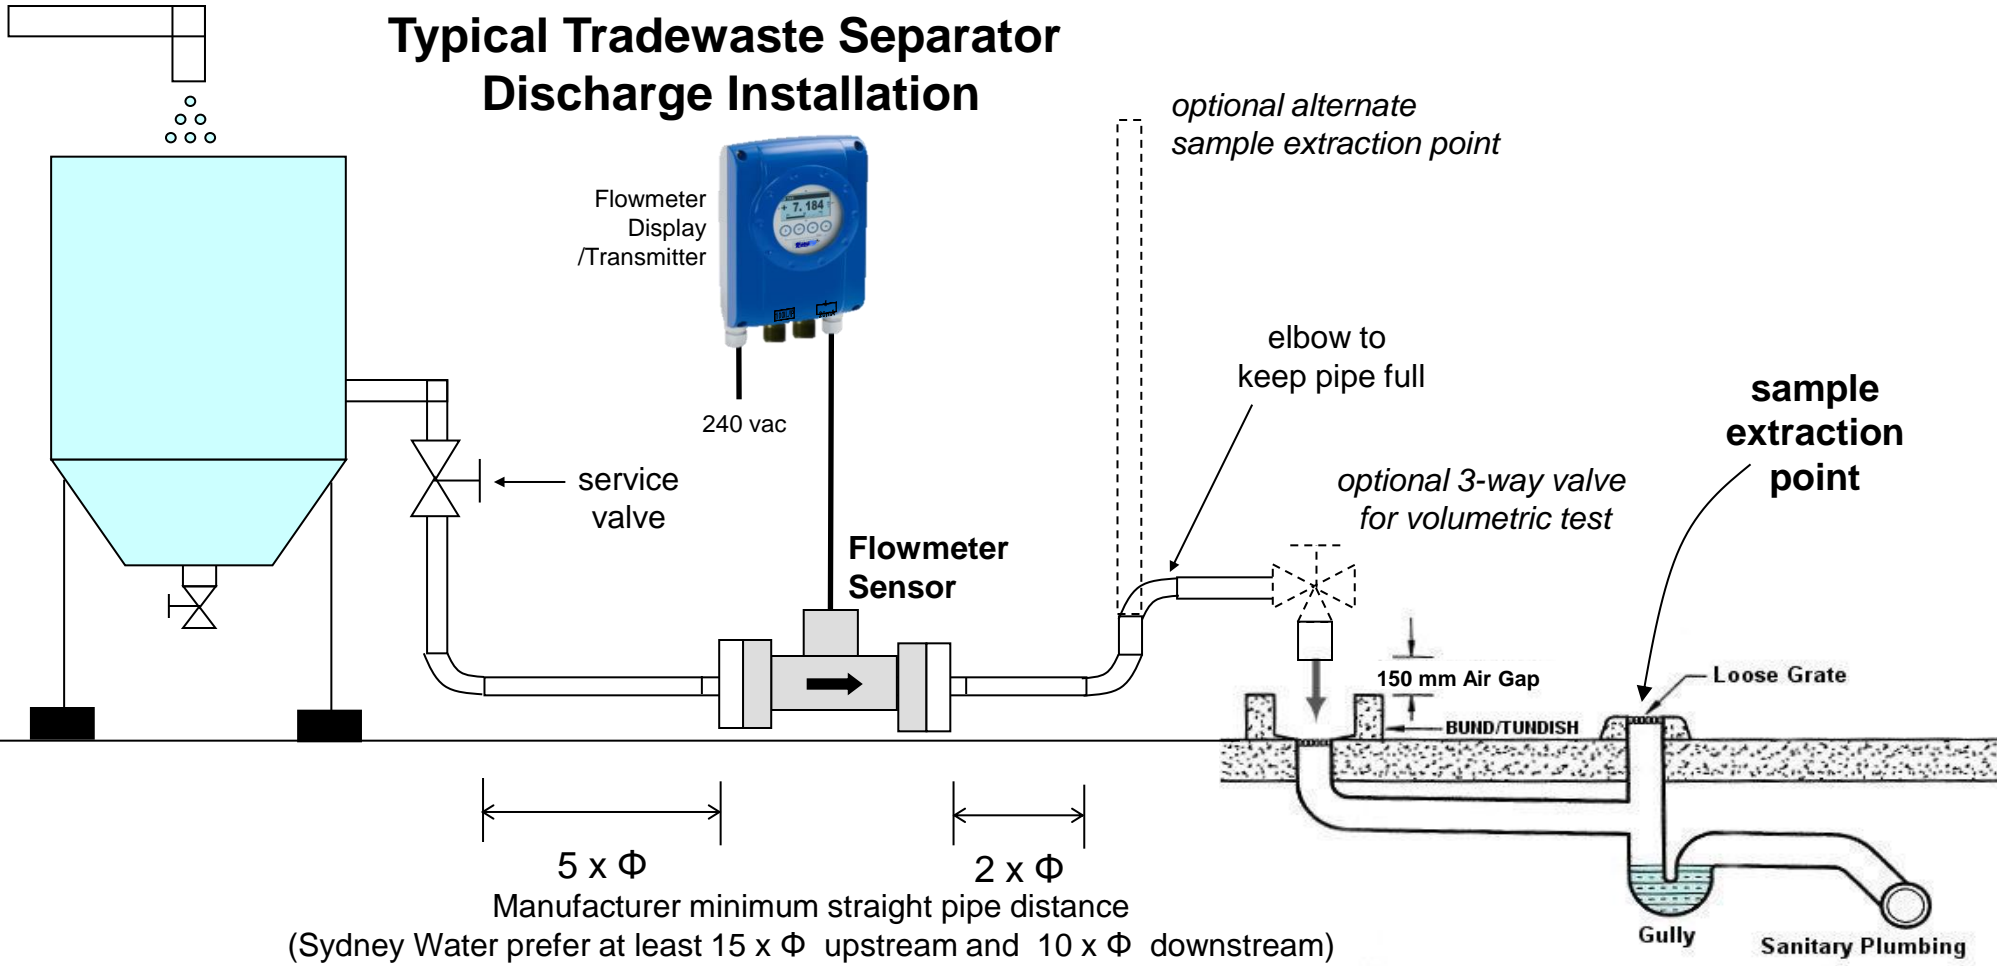

service valve

Flowmeter Sensor

optional alternate sample extraction point

elbow to keep pipe full

optional 3-way valve for volumetric test

sample extraction point


150 mm Air Gap

BUND/TUNDISH


Loose Grate

Gully

Sanitary Plumbing



5 x Φ



2 x Φ

Manufacturer minimum straight pipe distance

(Sydney Water prefer at least 15 x Φ upstream and 10 x Φ downstream)